



NOTES

1. LOCATE 4" VENT PIPE OUT OF TRAVELED WAY BEHIND THE CURB OR SIDEWALK OR AS REQUIRED BY THE PLANS.
2. TOP OF VENT SHALL BE A MINIMUM OF 1' ABOVE THE 100 YEAR FLOOD ELEVATION (HIGHER IF THE ELEVATION IS SHOWN ON THE PLANS).
- * 3. USE TREATED SUPPORT POST WHEN $H > 3.0'$.

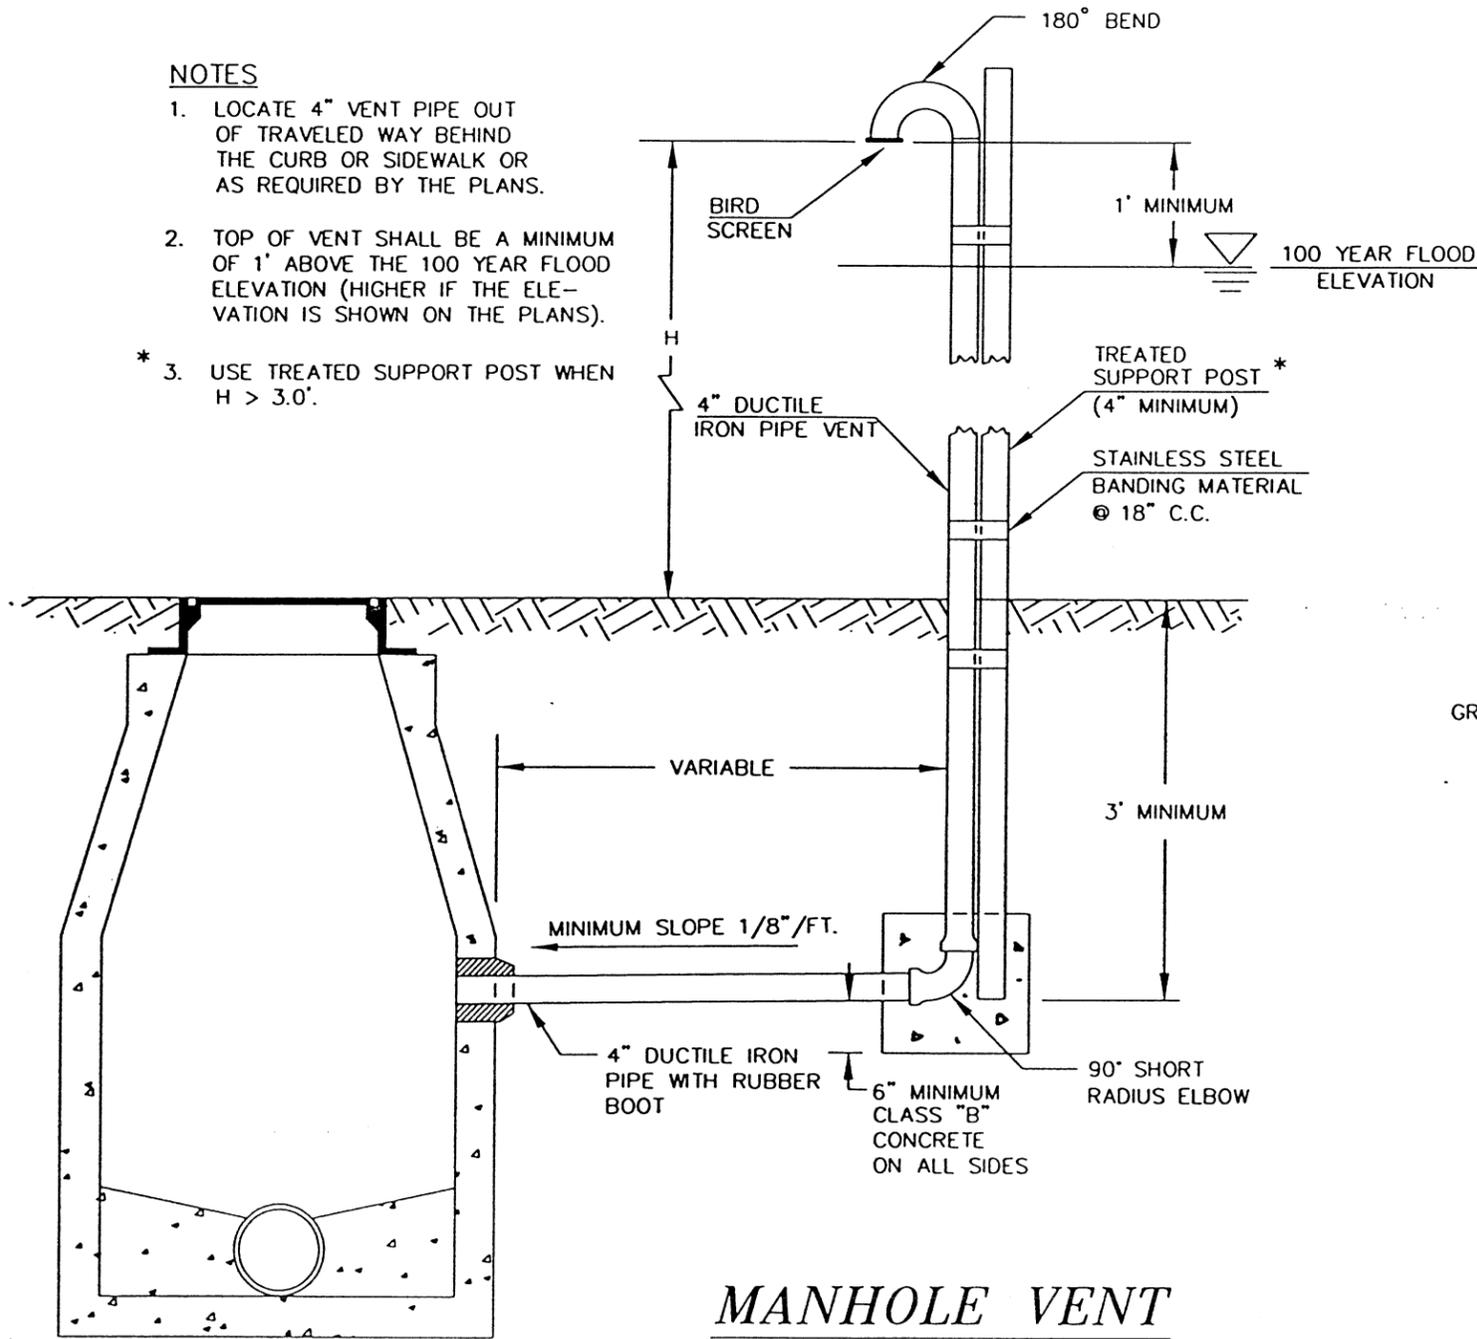

MANHOLE VENT

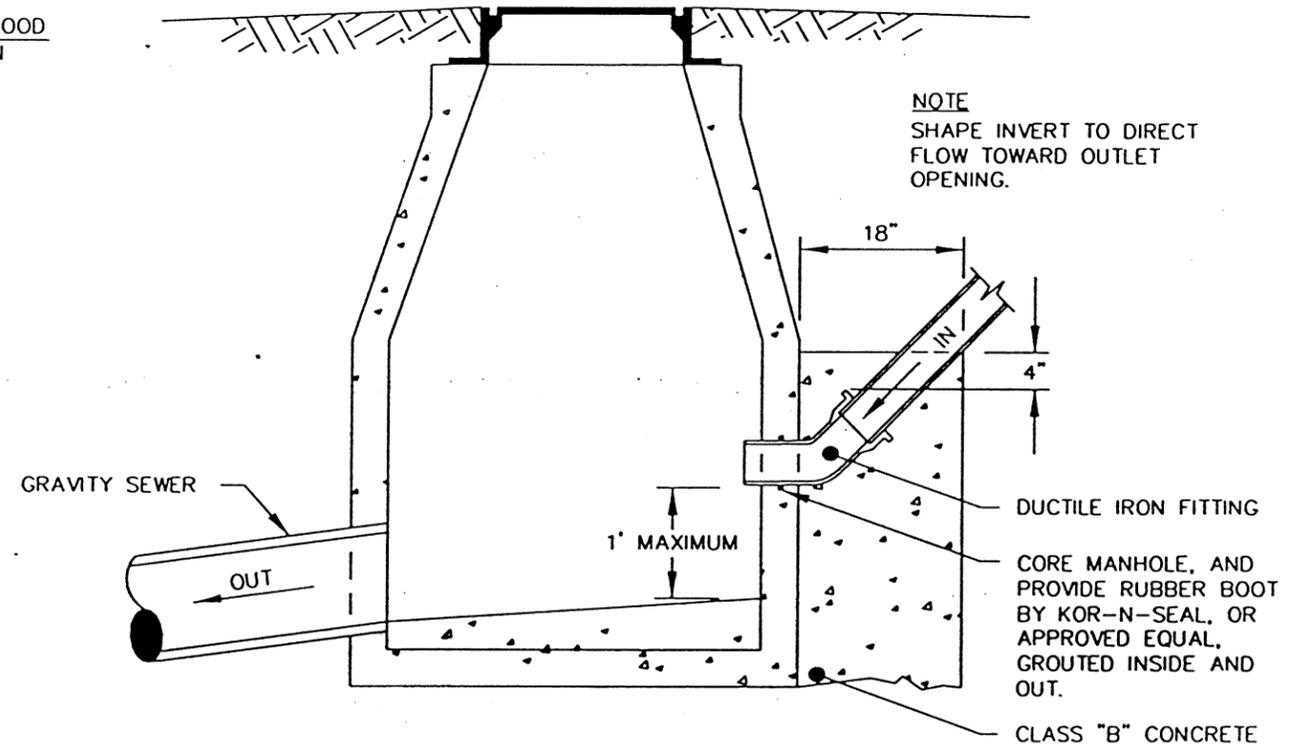

CONNECTION OF FORCE MAIN TO MANHOLE



0	INITIAL ISSUE	12/10/99
NO.	REVISION	DATE

CITY OF CHATTANOOGA AND HAMILTON COUNTY	
SANITARY/STORM MANHOLE DETAILS	
DATE OF ORIGINAL ISSUE DECEMBER 10, 1999	STANDARD NUMBER: SD-301.02